



Government Of West Bengal
Office Of The Director General
West Bengal Fire & Emergency Services
13D, Mirza Ghalib Street, Kolkata - 16

Memo no.:FSR/0125186231400045

Date: 05-06-2023

From:
Director
Fire Prevention Wing,
West Bengal Fire & Emergency Services

To: INSTITUTE OF EDUCATION HALDIA
Amlat, P.O SUTAHATA, Dist : Purba Medinipur

Sub: Fire Safety Recommendation for an existing construction of G+II storied under group occupancy Educational Building in the name & style "INSTITUTE OF EDUCATION HALDIA" at MOUZA -AMLAT, JL NO.-089, DAG NO. 780, WARD -01, P.O SUTAHATA, DIST : PURBA MEDINIPURFOR

This is in reference to your application no. 0125186231400045 dated 22-02-2023 regarding the Fire Safety Recommendation for an existing construction of G+II storied under group occupancy Educational Building in the name & style "INSTITUTE OF EDUCATION HALDIA" at MOUZA -AMLAT, JL NO.-089, DAG NO. 780, WARD -01, P.O SUTAHATA, DIST : PURBA MEDINIPURFOR

The plan submitted by you was scrutinized and marked as found necessary from Fire Safety point of view. In returning one set of plan with recommendation, this is issuing Fire Safety Recommendation in favor of the aforesaid building subject to the compliance of the following fire safety measure.

Recommendation:

CONSTRUCTION:

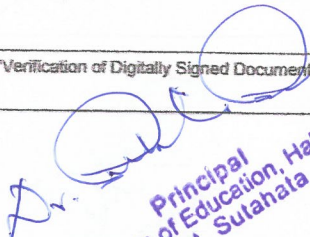
- 1.The whole construction of the ware house shall be carried out as per approved plan drawings conforming the relevant building rules of local Municipality/local Body.
- 2.The interior finish decoration of the building shall be made low flame spread materials conforming I.S. specifications.
- 3.Provision of ventilation at the crown of the central core-duct of the building shall be provided.
- 4.Arrangement shall have to be made for sealing all the vertical and horizontal ducts by the materials of adequate fire resisting capacity.

OPEN SPACE AND APPROACH:

- 1.The open spaces surrounding the building shall conform the relevant building rules as well as permit the accessibility and maneuverability of Fire Appliances with turning facility.
- 2.The approach roads shall be sufficiently strong to withstand the load of Fire Engine weighting 45M.T.
- 3.The width and height of the access gate into the premises shall not be less than 4.5 mts. and 5.0 mts. respecting the abutting road.

The authenticity of this document can be verified by accessing the URL: edistrict.wb.gov.in and then clicking on the "Verification of Digitally Signed Document" link and keying in the Unique Number : 0125186231400045.

Page : 1


Principal
Institute of Education, Haldia
Amlat SUTAHATA